


# X-RANGE ICX UNDERFLOOR OPTION WIRING DIAGRAM

230Vac 3amp  
SWITCHED  
FUSED SPUR



BLUE


G/YELLOW

GREY


BROWN

BLUE


ORANGE



ROOM THERMOSTAT




WIRING CENTRE




Parameter 081  
must adjusted to  
value '3'



HOT WATER  
TIMER



Orange & Grey  
wires from underfloor  
Zone are not required  
Isolate and make safe.



Switched Live from  
underfloor heating  
controls to X3 Pin 2

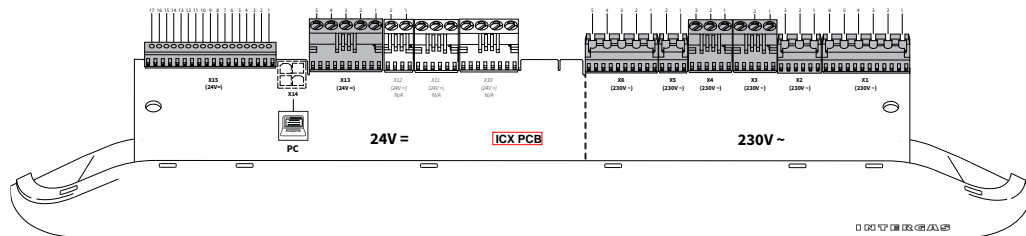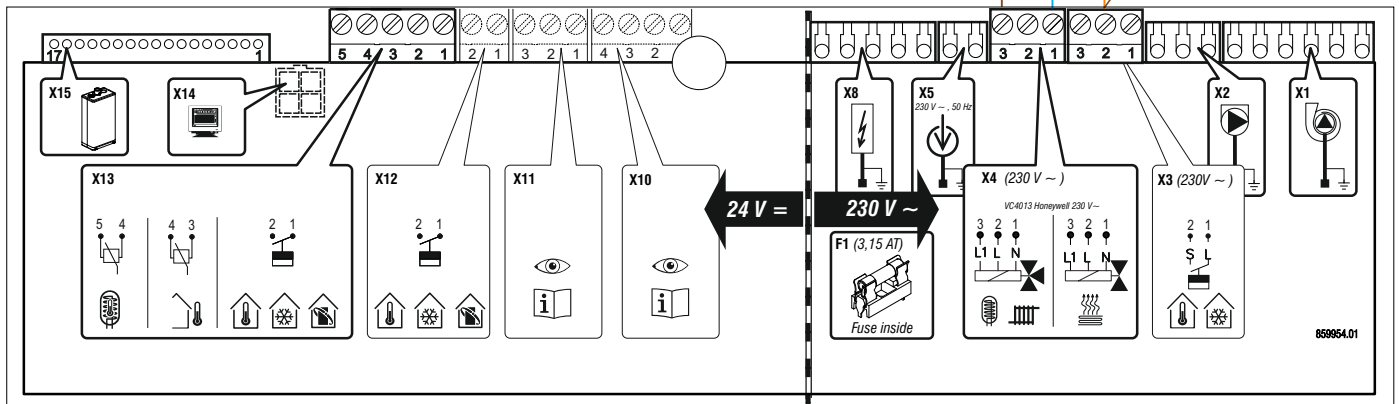

**INTERGAS**  
BOILERS